
CONTROL JOINT OR CRACKED SUBSTRATE (PARTIAL COVERAGE)

(NOT TO SCALE)

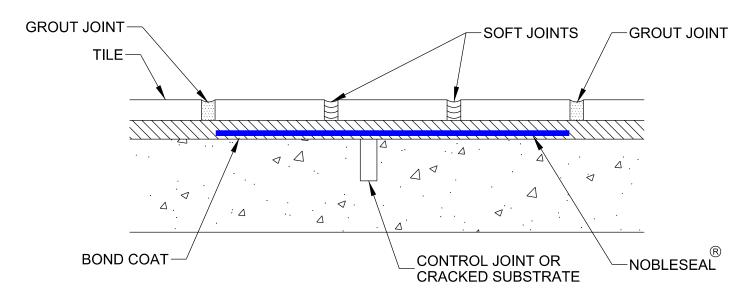

CONTROL JOINTS (CONSTRUCTION, ISOLATION, CONTRACTION)

NOTES:

- 1. ONE SOFT JOINT CLOSE TO JOINTS/CRACKS IN SUBSTRARATE IS REQUIRED; TWO ARE RECOMMENDED
- 2. SHEET WIDTH SHOULD EQUAL AT LEAST 3 TILES (ONE FULL TILE OVER JOINT PLUS ONE TILE ON EITHER SIDE). 24" MINIMUM SHEET WIDTH.
- 3. USE OF NOBLESEAL DOES NOT NEGATE THE NEED FOR MOVEMENT JOINTS IN THE TILE FIELD IN ACCORDANCE WITH TCNA DETAIL EJ171.

Revision Dat

Ile CONTROL JOINT OR CRACKED SUBSTR